
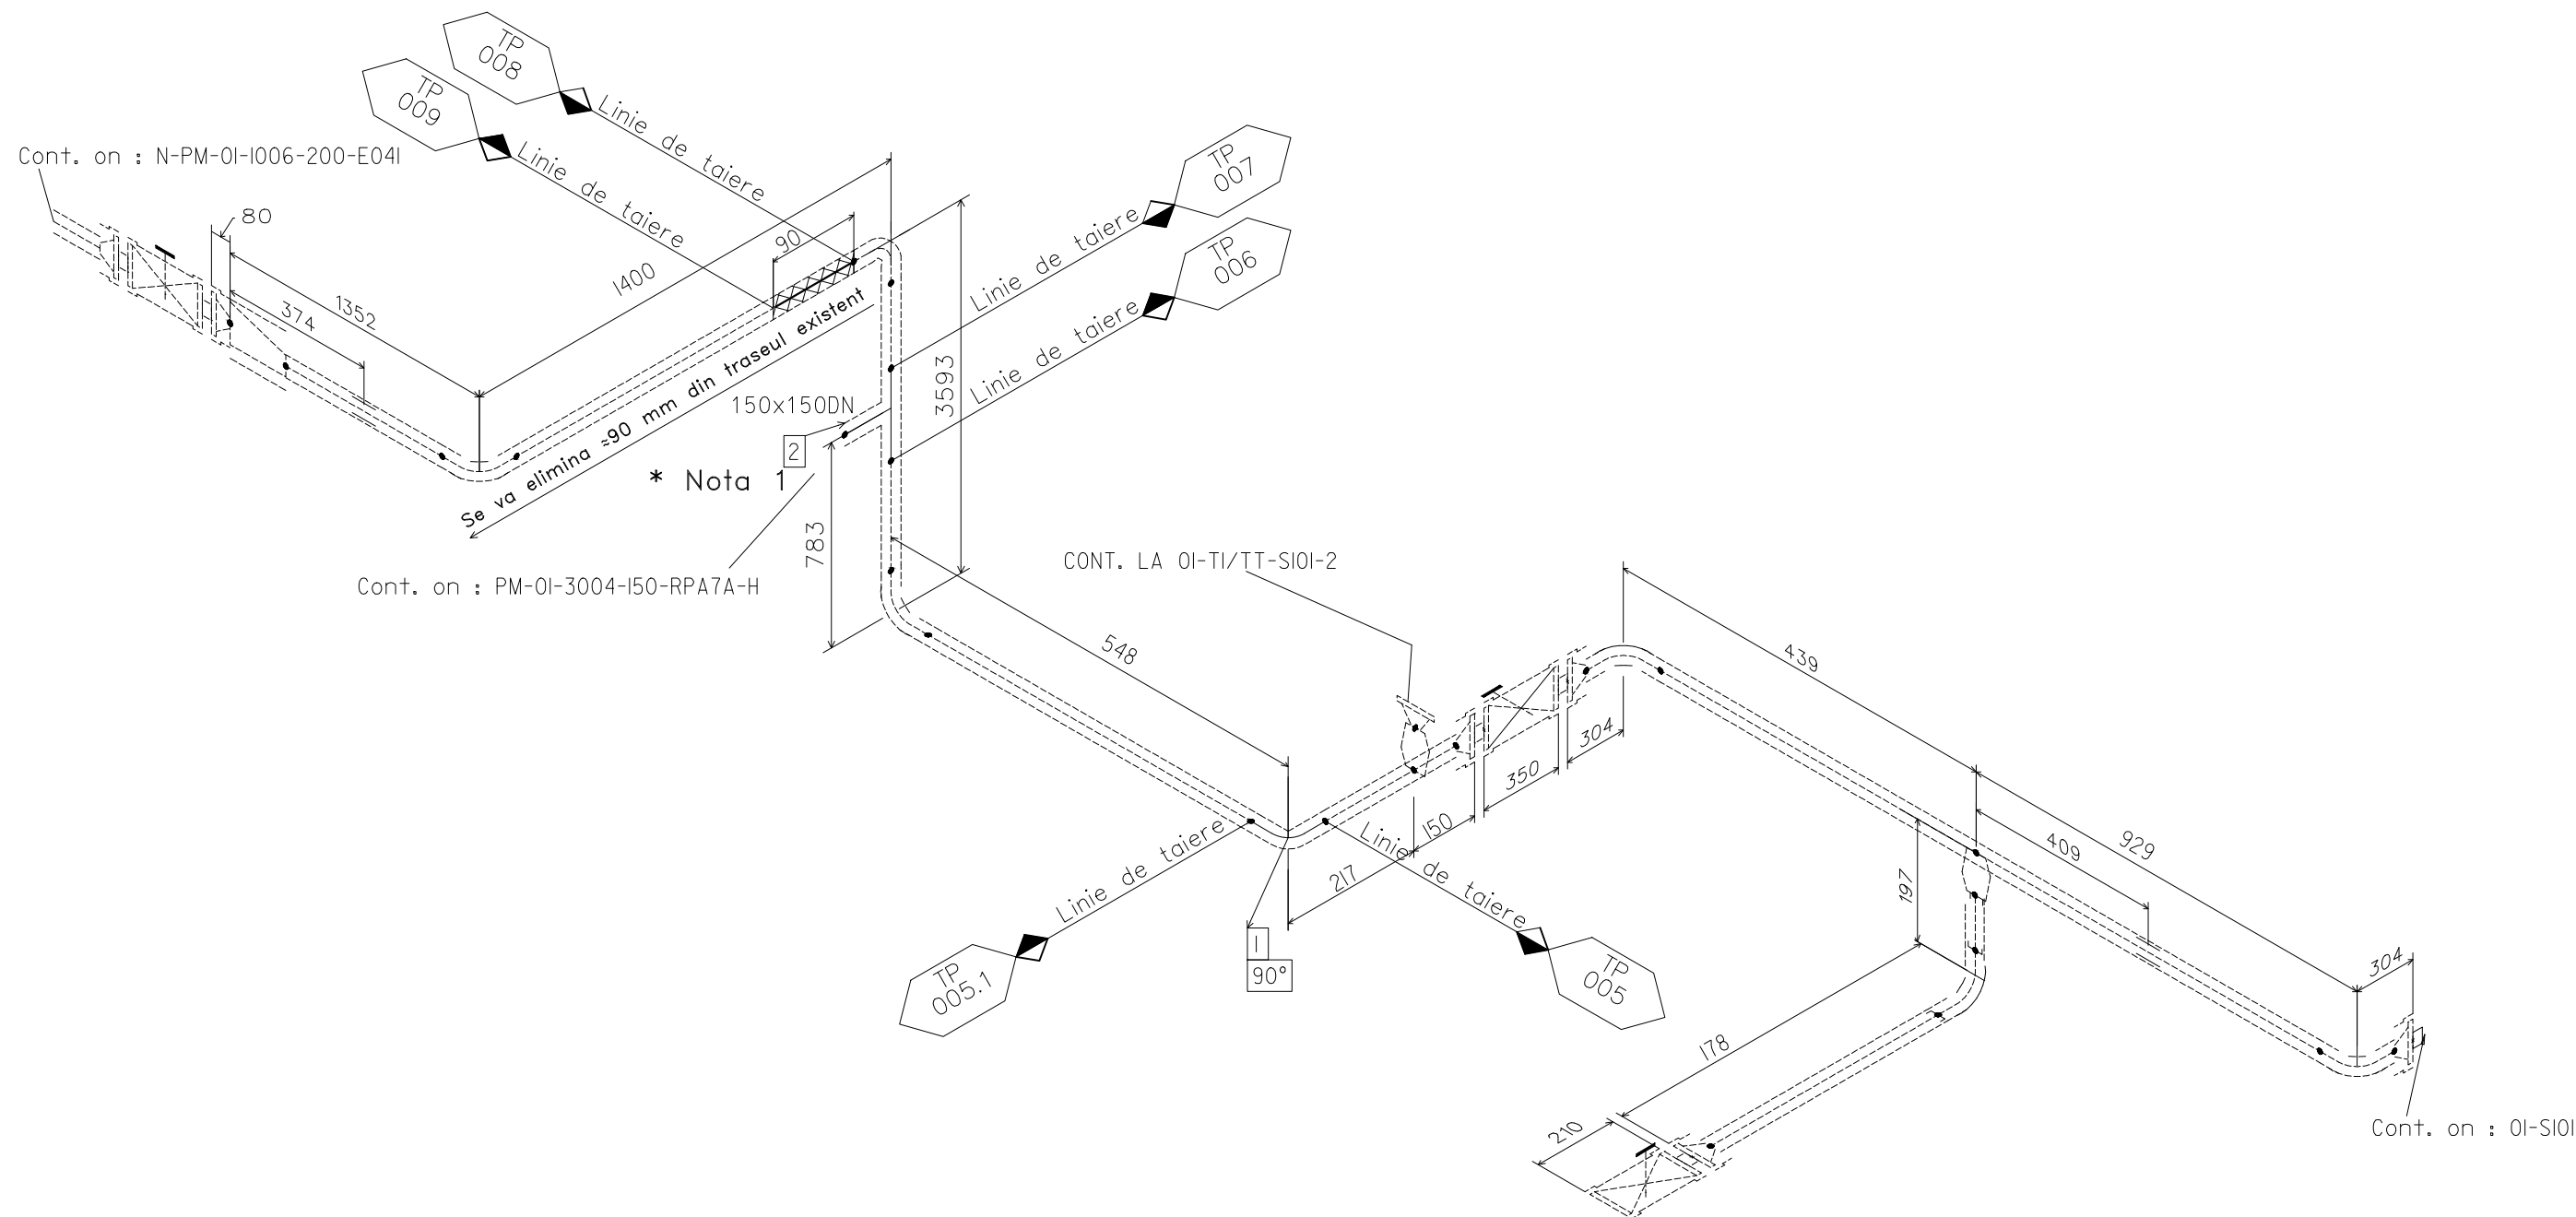




LEGENDA:

Tie-in

 TRASEU ELIMINAT

Note

1. Teul egal se va refolosi din traseul existent

NOTE:		DE LA 01-S101	FLUID DE LUCRU	PM	PROIECTARE	TEMP. [°C]	250	DOCUMENTE DE REFERINTA:	
1. Inainte de a se realiza asamblarea finala a conductei executantul are obligatia de a realiza masuratori in teren, in vederea asigurarii corespundentei dintre izometrie si teren. 2. Locul sudurii de montaj si a placutei de timbru se va stabili de catre executant. 3. In situatia in care suportarea liniilor DN50 si mai mici nu este indicata va fi facuta de executant. 4. Panta de montaj se va asigura catre punctele de drenare	5. CTA = Cota teren amenajat 6. Toate cotele de nivel sunt referinta CTA 7. Dimensiunile sunt in mm data nu este altfel specificat.	LA N-PM-01-1006-200-E041	FLUID SPECIAL	NJ	OPERARE	PRES. [bar]	112	SCHEMA TEHNOLOGICA	30-0004.04; 30-0093.03
		TIP H Gr. [mm] 60	GRUPA DE FLUID(PED)	I		TEMP. [°C]	118	CLASA CONDUCTE	RPA7A
			CAT. CONDUCTA (PED)	II		PRES. [bar]	7.3	SPEC. VOPSITORIIE	1331PJ-UE217-100-001
	INSOTITORI	NJ	CONTROL NEDISTRUCTIV			FLUID	APA	SISTEM DE STRES	DA
	GROSIME DE INLOCUIRE TEAVA		TIP	Rx		PRESIUNE		PRES. [bar]	24
		DN 150		(%) 100	DE TEST	TEMP. [°C]	20	PLANURI AMPLASARE CONDUCTE:	
		Gr. (mm) 3.2	NACE	NJ		PWHT	NJ	1331PJ-UE206-100-001	

LISTA MATERIALE

[illegible]