




Comanda	Dosar reparatie	Aria/Sector	Instalatie	Pozitie montaj	Tip Utiliaj
180000 38625	03 - CI 0291	3	Cocsare	01 - VA3	Ventilator VPV

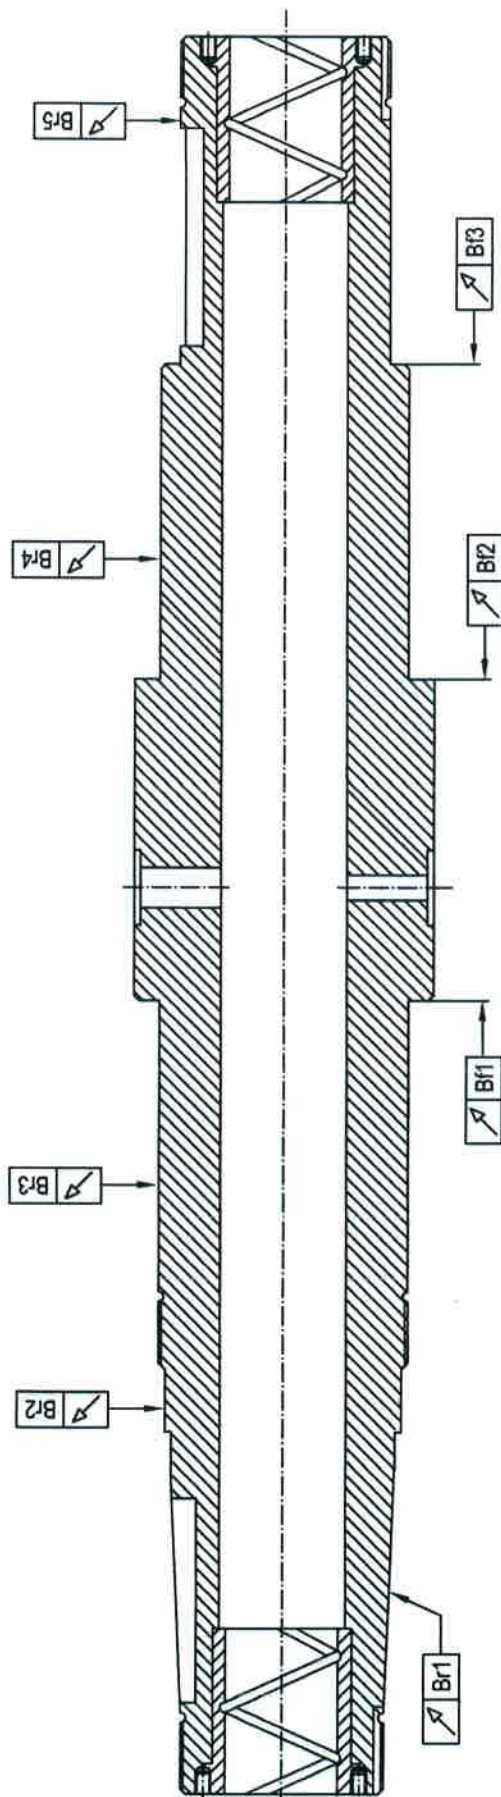


BATAI RADIALE SI FRONTALE ALE ARBORELUI TUBULAR

Zona de masurare	Br1	Br2	Br3	Br4	Br5	Br1	Br2	Br3
La demontare	0,020	0,020	0,020	0,020	0,020	0,010	0,010	0,010
La montaj	0,020	0,020	0,020	0,020	0,020	0,010	0,010	0,010

	Verificat/completat maestru TURBOCOM E. C.	Masurat sef echipa TURBOCOM E. C.
Nume, pre-nume	Serban Ion	Ionita Ion
Data	15.10.2019	15.10.2019
Semnatura		

Comanda	Dosar reparatie	Aria/Sector	Instalatie	Pozitie montaj	Tip Utilaj
180000 38625	03 - CI 0291	3	Cocsare	01 - VA3	Ventilator VPV

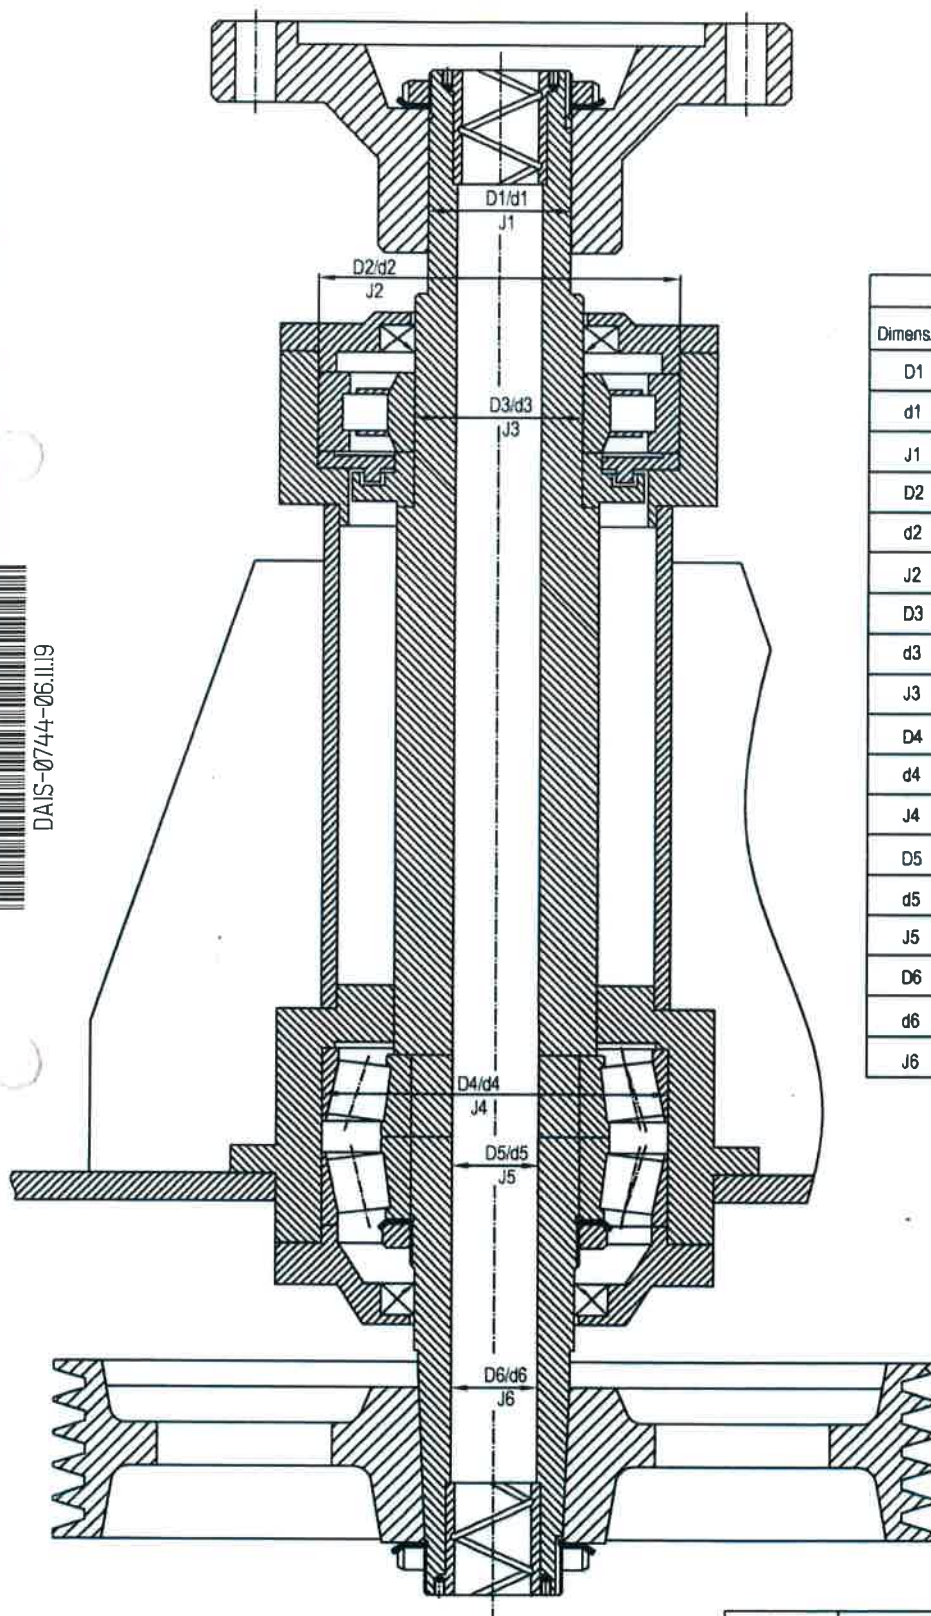

JOCURI SUBANSAMBLU [mm]

Dimensiune	La demontare	La montaj	Recomandat
D1	Ø85,050	Ø85,050	
d1	Ø84,97	Ø84,97	
J1	0,080	0,080	
D2	Ø215,020	Ø215,020	
d2	Ø215,00	Ø215,00	
J2	+ 0,020	+ 0,020	
D3	Ø99,99	Ø99,99	
d3	Ø100,025	Ø100,025	
J3	- 0,035	- 0,035	
D4	Ø215,020	Ø215,020	
d4	Ø215,00	Ø215,00	
J4	+ 0,020	+ 0,020	
D5	Ø99,99	Ø99,99	
d5	Ø100,025	Ø100,025	
J5	- 0,035	- 0,035	
D6	Ø90,050	Ø90,050	
d6	Ø89,95	Ø89,95	
J6	+ 0,100	+ 0,100	

	Verificat/completat maistru TURBOCOM E. C.	Masurat sef echipa TURBOCOM E. C.
Nume, prenume	Serban Ion	Ionita Ion
Data	15.10.2019	15.10.2019
Semnatura		

DAIS-0744-06.II.19