

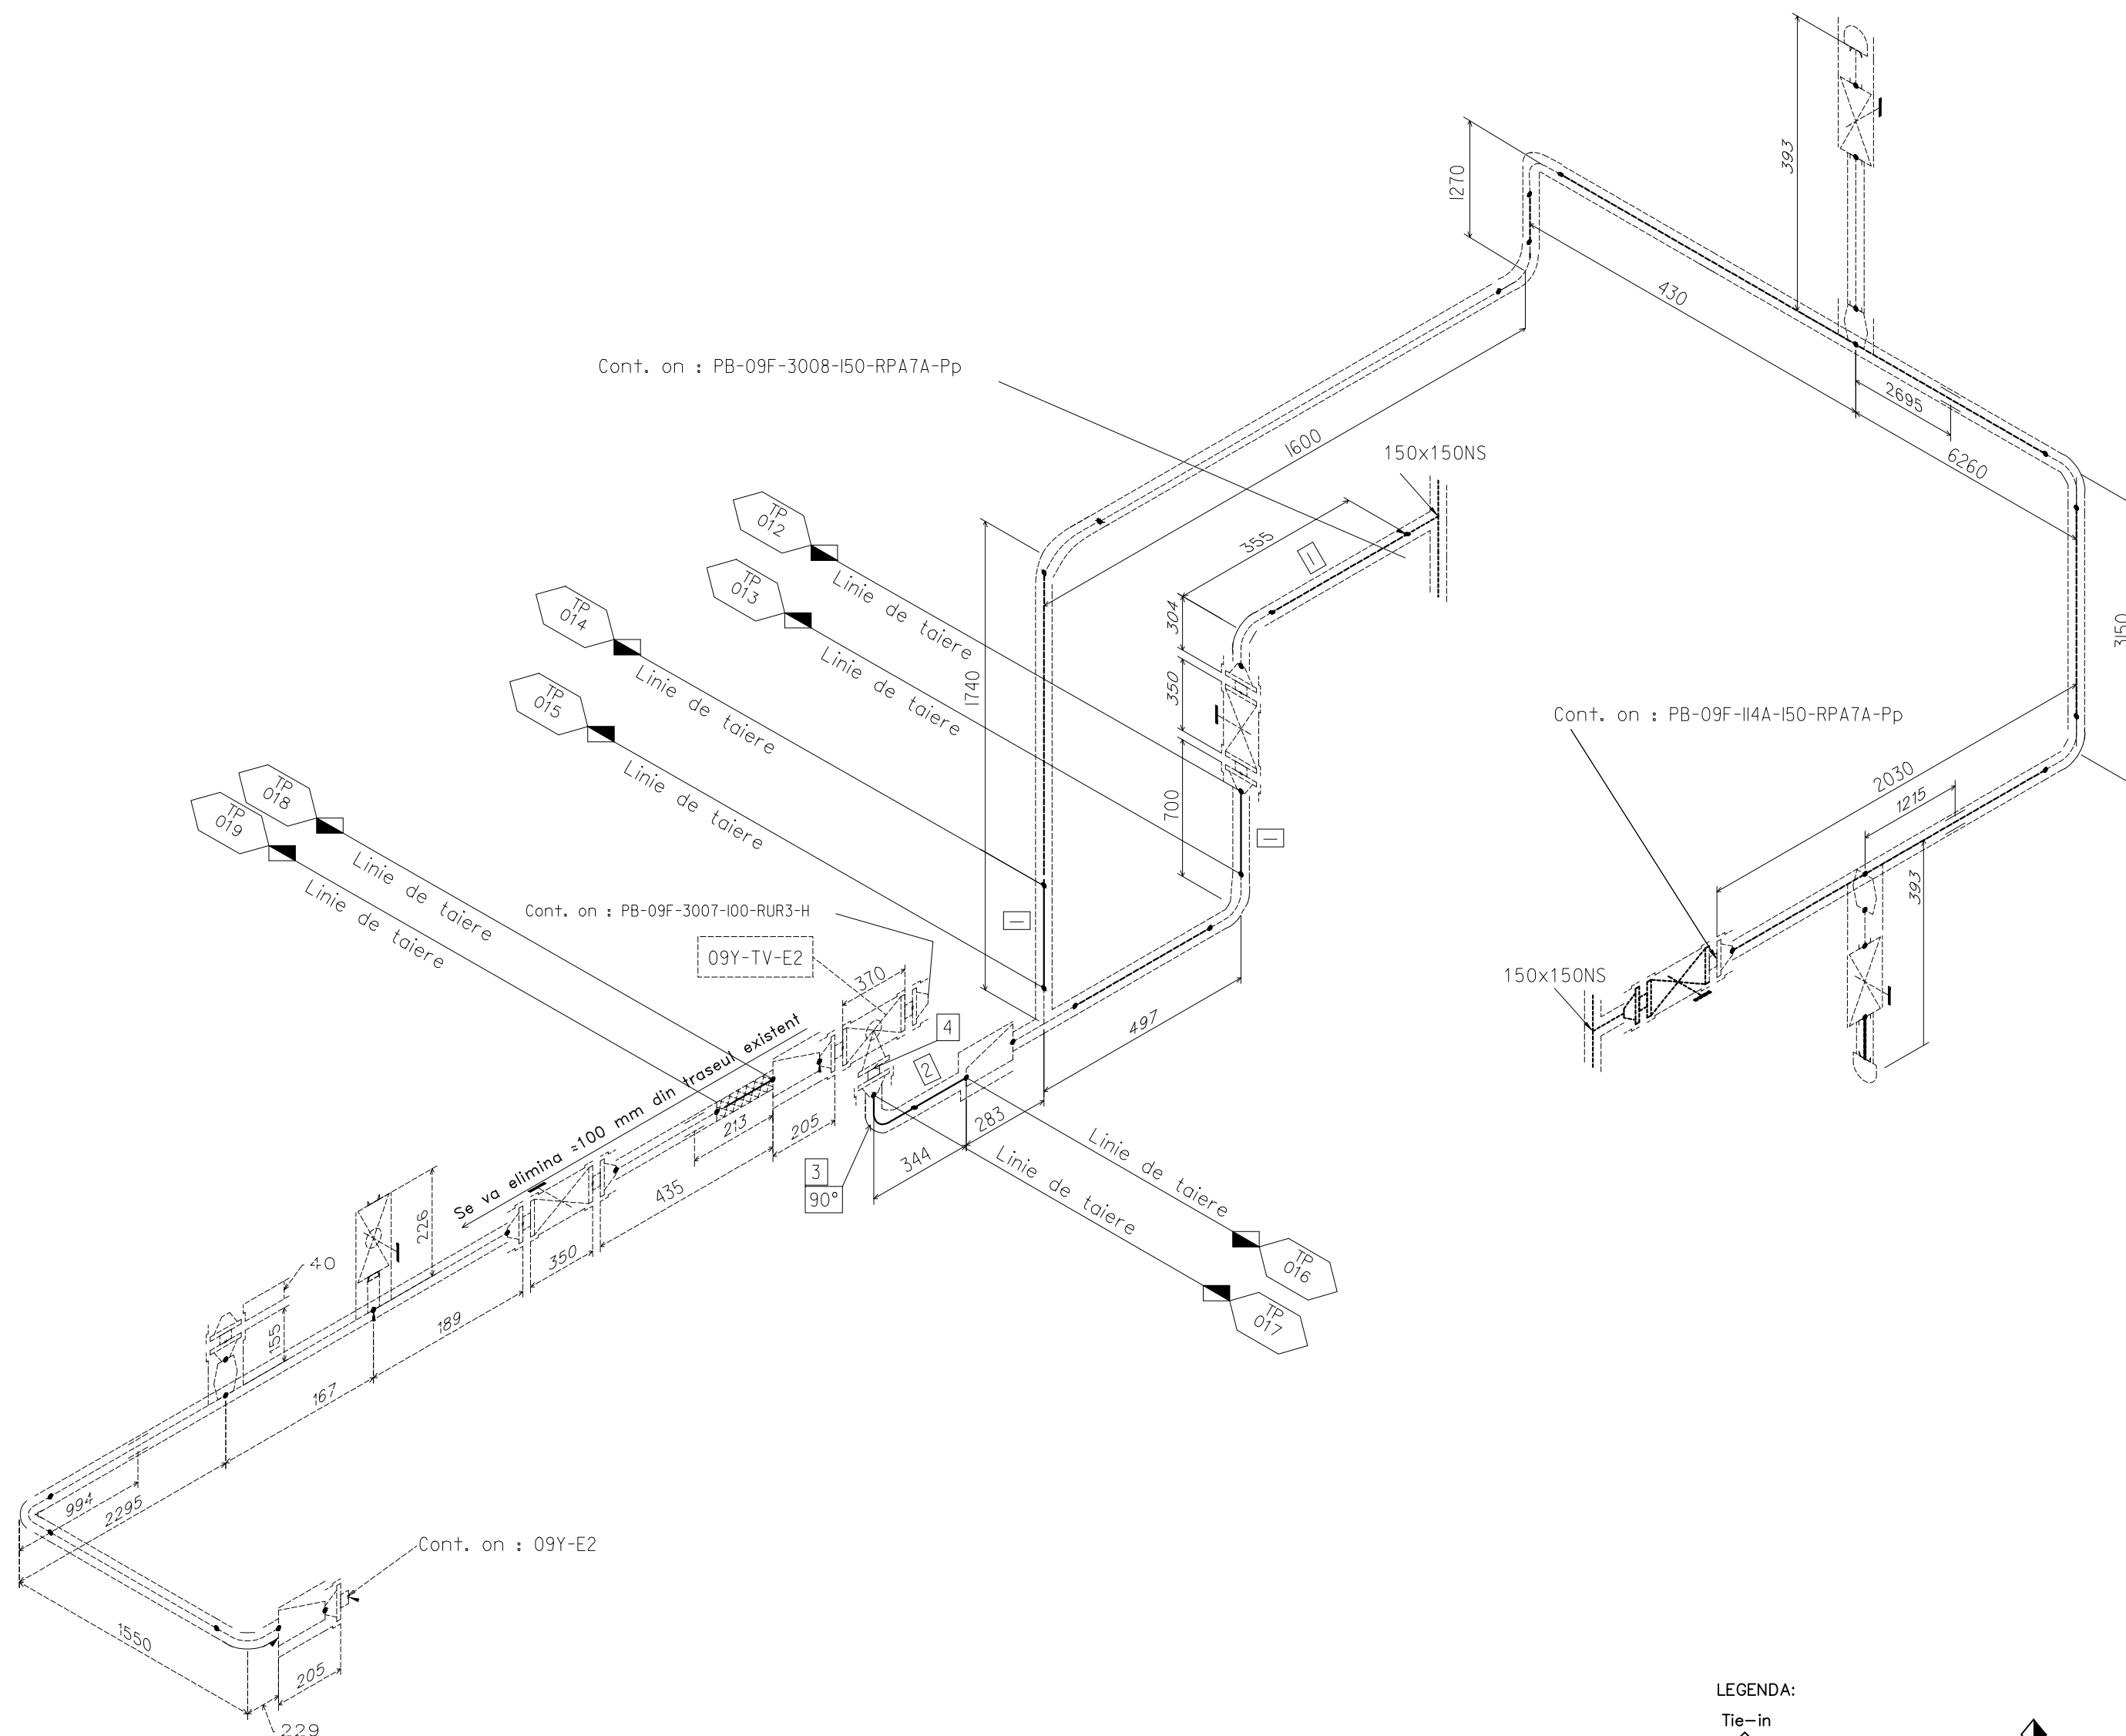




LEGENDA:



EXISTENT ——— NOU

TRASEU ELIMINAT

NOTE :

- | | |
|--|--|
| 1. Inainte de a se realiza asamblarea finala a conductei executantul are obligatia de a realiza masuratori in teren, in vederea asigurarii corespundentei dintre izometrie si teren. | 5. CTA = Cota teren aneajajat |
| 2. Locul sudurii de montaj si a placutei de timbru se va stabili de catre executant. | 6. Toate cotele de nivel sunt referinta CTA |
| 3. In situatia in care suportarea liniilor DNS0 si mai mici nu este indicata va fi facuta de executant. | 7. Dimensiunile sunt in mm daca nu este altfel specificat. |
| 4. Panta de montaj se va asigura catre punctele de drenare | |

LIMITE LA	PB-09F-114-150-RUR3		FLUID DE LUCRU		PB	PROIECTARE	TEMP. [°C]	200	DOCUMENTE DE REFERINTA:	
	09Y-E2		FLUID SPECIAL		NU		PRES. [bar]	12	SCHEMA TEHNOLOGICA 36-0921.03-2; 36-0925.03-1	
IZOLATIE	TIP	H	GRUPA DE FLUID(PED)		1	OPERARE	PRES. [°C]	135	CLASA CONDUCTE 36-0921.03-2; 36-0925.03-1	
	Gr. [mm]	60	CAT. CONDUCTA(PED)		II		PRES. [bar]	7	SPEC. VOPSITORIE 1331PJ-UE217-200-001	
INSOTITORI	NU		CONTROL NEDISTRUCTIV			PRESIUNE DE TEST	FLUID	APA	SISTEM DE STRES DA	
GROSIME DE INLOCUIRE TEAVA			TIP	Rx			PRES. [bar]	18	SUPORTURI 1331PJ-UE213-200-001	
DN	150		[%]		100	DE PWT	TEMP. [°C]	20	PLANURI AMPLASARE CONDUCTE:	
Gr. [mm]	4,7		NACE		NU		NU	1331PJ-UE206-200-001		

LISTA MATERIALE

Nr.	DN	DESCRIERE	MATERIAL	STANDARD	CANTITATE	GREUTATE (Kg)
1	6"	TV.FARA SUDURA, SCH.40, (168.3x7.11)	A53 GR.A TYPE S	B36.10	940	
2	4"	TV.FARA SUDURA, SCH.40, (114.3x6.02)	A53 GR.A TYPE S	B36.10	100	
3	4"	COT 90°, RAZA LUNGA, BW, SCH.40, (114.3x6.02)	P235GH	B16.9	1	
4	4"	GARNIT. SPIROMET., PN25, B1, 4.5mm	B04SS/GRAFIT	EN 1514-2	1	

Nr.	DN	DESCRIERE				MATERIAL	STANDARD	CANTITATE	GREUTATE (Kg)
00	M.Ghita	R.Dobre	L.Nare	11.09.2019	Aprobat pentru construire				
Rev.	Proiectat	Desenat	Verificat	Data	Descrierea reviziei				
	Name	Signature	Date	Project Nr.: 1331PJ Beneficiar:					
Proiectat	L.Vasile		03.12.2018	DTDE Denumire Proiect: INCALZIREA APEI DEMINERALIZATE PRIN RECUPERAREA CALDURII DE PROCES DIN SECTOARELE 1 SI 2					
Desenat	L.Vasile		03.12.2018						
Verificat	L.Nare		03.12.2018						
Aprobat	R.Falup		03.12.2018						



Numar linie: PB-09F-114A-150-RUR3-H

Desen Nr.: 1331PJ-UE207-200-103

Fila:
1 / 1